

BETO direct / indirect


free standing U-shape
074-6944617R



Project / Type _____

Notes _____

Count / Date _____

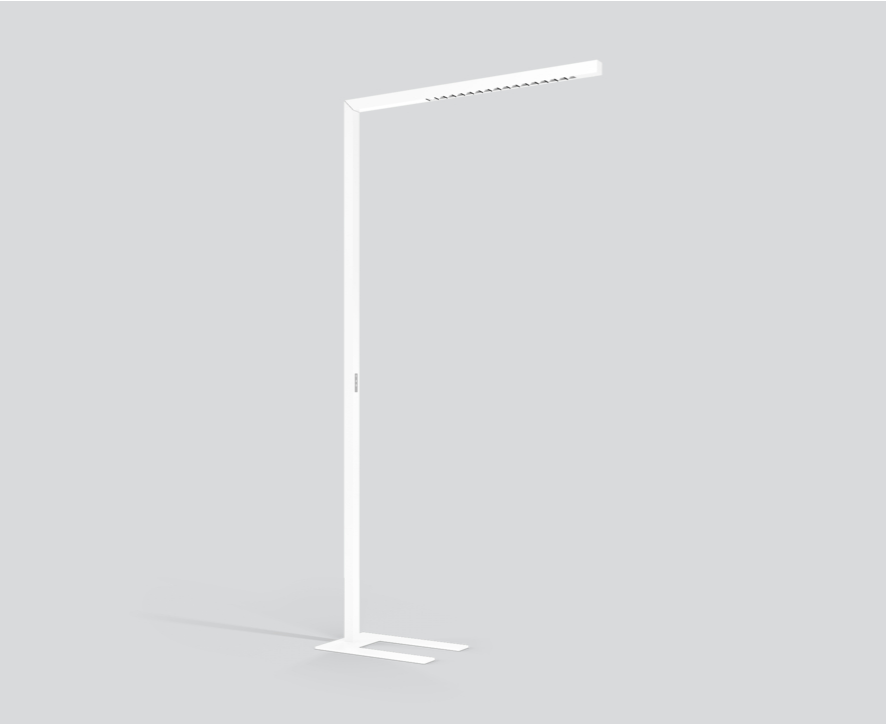

General

Floor , Standing _____

white , RAL 9010 ¹ _____

Reflector chrome _____

IP20 _____

indirect 5710 lm _____

direct 2030 lm _____

total 7740 lm _____

LED

4000 K _____

CRI ≥ 80 _____

L90 / 50000 h _____

initial MacAdam ≤ 3 SDCM _____

MR 0.72 _____

MDER 0.65 _____

Optical

Reflector _____

asymmetric _____

UGR < 13 _____

PstLM ≤ 1.0 ² _____

SVM ≤ 0.4 ² _____

Electrical

touch DIM on pole _____

220-240 V _____

system 51 W _____

system 152 lm/W³ _____

PC1 _____

Physical

U-shape _____

length 1055 mm _____


width 42 mm _____

height 2100 mm _____


11.7 kg _____

¹ RAL code ² Value of containing product at full load (undimmed)
³ FIXTURE: incl. consideration of optical losses & internal control unit losses SYSTEM: incl. consideration of optical losses, internal control unit losses & operating device efficiency.

Light distribution



Product drawing



Installation instructions



BETO direct / indirect

free standing U-shape

074-6944617R



Project / Type

Notes

Count / Date

Maintenance Factors

Operating Time [h]	10 000	20 000	30 000	40 000	50 000
LLMF	0.98	0.96	0.94	0.92	0.9
LSF	1	1	1	1	1

MF

LMF × RSMF × LLMF × LSF

MF

Maintenance Factor

LMF^a

Luminaire Maintenance Factor

RSMF^a

Room Surface Maintenance Factor

LLMF

Lamp Lumens Maintenance Factor

LSF

Lamp Survival Faktor

^a According to "CIE 97, Maintenance of indoor electric lighting systems", 2005, ISBN 3-900-734-34-8. The values must be determined by the planner.

Circuit Breaker Types

Automatic Circuit Breaker Type	Number of Fixtures
B10	13
B13	17
B16	21
B20	26
C10	21
C13	28
C16	35
C20	43

