

# BASO 40opal

trim


045-0524637H



Project / Type

Notes

Count / Date

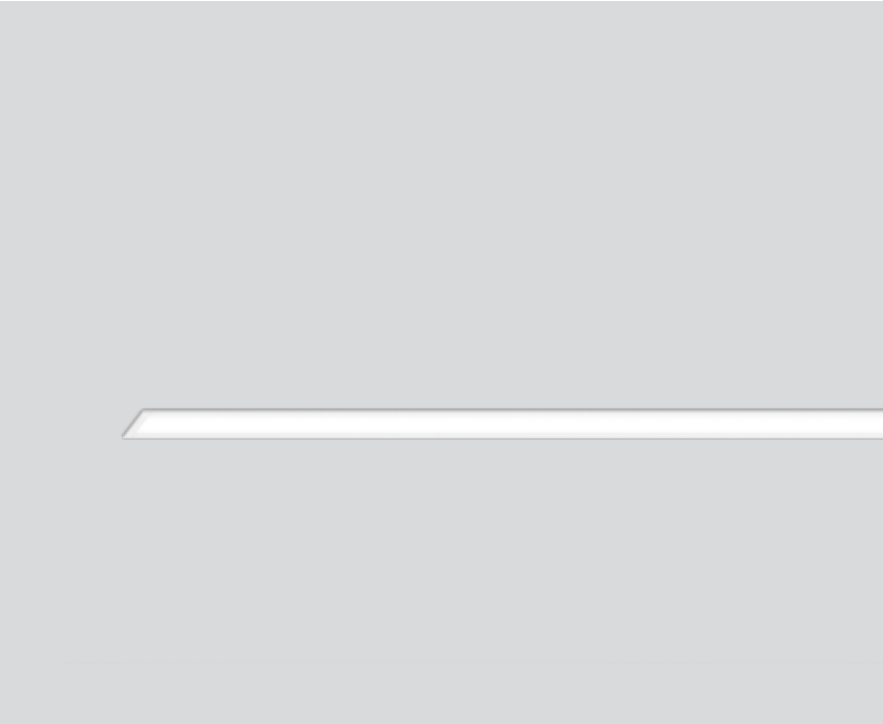

RG0

IEC 62471

220-240V

X-PERT

X-PERT

### General

Ceiling , Recessed

white , RAL9016 <sup>1</sup>

2340 lm/m

IP20

2810 lm

### LED

4000 K

CRI ≥ 80

L90 / 50000 h

photobio. safety RG 0 - no Risk

initial MacAdam ≤ 3 SDCM

MR 0.72

MDER 0.66

### Optical

High Performance Opal

opal (lambertsch)

PstLM ≤ 1.0 <sup>2</sup>

SVM ≤ 0.4 <sup>2</sup>

### Electrical

DALI-2

system 27.5 W

PC1 220-240V

system 102 lm/W<sup>3</sup>

1 DALI Addr.

23 W/m

### Physical

trim

length 1219 mm

width 57 mm

height 75 mm

2.1 kg

### Cutout

length 1209 mm

width 48 mm

min. ceiling thickness 8 mm


max. ceiling thickness 20 mm

recessed depth 100 mm


<sup>1</sup> RAL code <sup>2</sup> Value of containing product at full load (undimmed)

<sup>3</sup> incl. optical losses and the efficiency of the operating device (converter)

### Light distribution



### Product drawing



### Installation instructions



### Lighting calculator



# BASO 40 opal

trim

045-0524637H



Project / Type

Notes

Count / Date

## Maintenance Factors

Operating Time [h]	10 000	20 000	30 000	40 000	50 000
LLMF	0.98	0.95	0.93	0.91	0.9
LSF	1	1	1	1	1
MF	LMF × RSMF × LLMF × LSF		RSMF <sup>a</sup>	Room Surface Maintenance Factor	
MF	Maintenance Factor		LLMF	Lamp Lumens Maintenance Factor	
LMF <sup>a</sup>	Luminaire Maintenance Factor		LSF	Lamp Survival Faktor	

<sup>a</sup> According to "CIE 97, Maintenance of indoor electric lighting systems", 2005, ISBN 3-900-734-34-8. The values must be determined by the planner.

## Circuit Breaker Types

Automatic Circuit Breaker Type	Number of Fixtures
B10	18
B13	23
B16	28
B20	35
C10	30
C13	38
C16	46
C20	58

