

# INO TRIPLE circle

suspended


034-384563XH



Project / Type \_\_\_\_\_

Notes \_\_\_\_\_

Count / Date \_\_\_\_\_

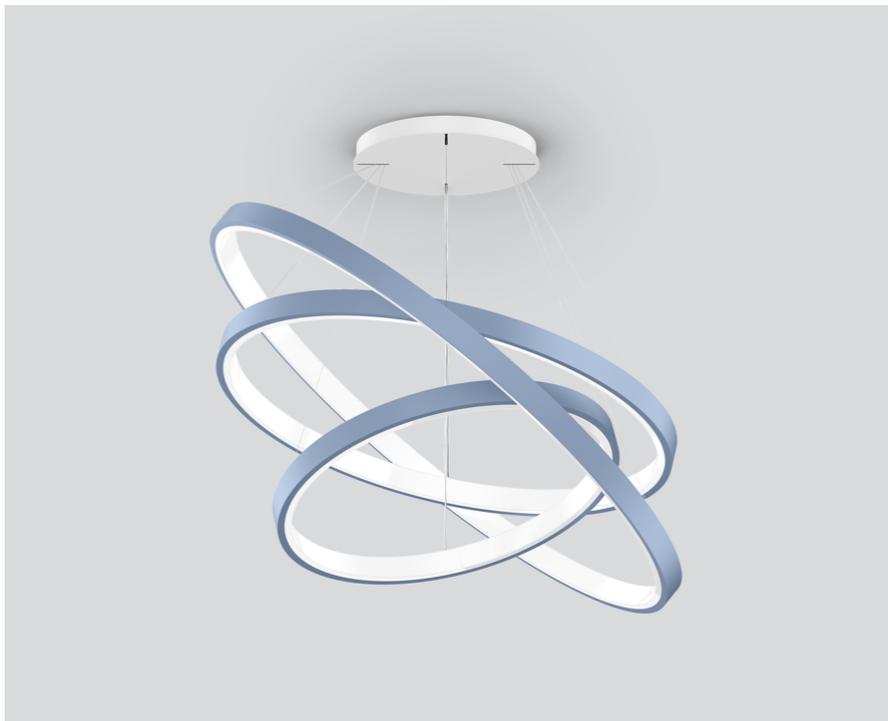

## General

Ceiling , Suspended \_\_\_\_\_

special colours \_\_\_\_\_

IP20 \_\_\_\_\_

direct 16700 lm \_\_\_\_\_

total 20200 lm \_\_\_\_\_

## LED

4000 K \_\_\_\_\_

CRI  $\geq$  90 \_\_\_\_\_

L90 / 50000 h \_\_\_\_\_

initial MacAdam  $\leq$  3 SDCM \_\_\_\_\_

R<sub>g</sub>: 99 , R<sub>r</sub>: 92 , R<sub>(1-15)</sub>: 90 \_\_\_\_\_

MR 0.81 \_\_\_\_\_

MDER 0.74 \_\_\_\_\_

## Optical

High Performance Opal \_\_\_\_\_

opal (lambertsch) \_\_\_\_\_

PstLM  $\leq$  1.0 <sup>1</sup> \_\_\_\_\_

SVM  $\leq$  0.4 <sup>1</sup> \_\_\_\_\_

## Electrical

DALI-2 \_\_\_\_\_

220-240 V \_\_\_\_\_

system 150 W \_\_\_\_\_

PC1 \_\_\_\_\_

3 DALI Addr. \_\_\_\_\_

## Physical

cable 5000 mm \_\_\_\_\_

diameter 1455 mm \_\_\_\_\_

height 60 mm \_\_\_\_\_

5.4 kg \_\_\_\_\_

3 pcs. ring-shaped light fittings in rolled and seamlessly welded extruded aluminium profile; surface special colours powder coated; suspended luminaire with 5000mm cable suspension (canopy central); height adjustment without tools; light fitting individually height adjustable; incl. transparent feed; 3 pcs. electronic operating units installed in the canopy; light colour 4000 K; binning initial MacAdam  $\leq$  3 SDCM; CRI  $\geq$  90; min. 90% of luminous flux after 50000 operating hours; energy efficient LEDs with high CRI; HPO (High Performance Opal) cover for uniform illumination; inwards facing emission characteristics; direct/indirect light emission for additional accentuation of the ceiling; canopy with 2 cable openings and plug-in terminal for through wiring; degree of protection IP20; PC1; internal wiring in light halogen free; incl. 3 pcs. DALI-2 converters; light fitting separately controllable; light source replaceable by an authorized professional; control gear replaceable by an authorized professional;

## Product drawing



<sup>1</sup> Value of containing product at full load (undimmed)

## Installation instructions



# INO TRIPLE circle

suspended

034-384563XH



Project / Type

Notes

Count / Date

## Maintenance Factors

Operating Time [h]	10 000	20 000	30 000	40 000	50 000
LLMF	0.98	0.96	0.94	0.92	0.9
LSF	1	1	1	1	1

MF	LMF × RSMF × LLMF × LSF	RSMF <sup>a</sup>	Room Surface Maintenance Factor
MF	Maintenance Factor	LLMF	Lamp Lumens Maintenance Factor
LMF <sup>a</sup>	Luminaire Maintenance Factor	LSF	Lamp Survival Faktor

<sup>a</sup> According to "CIE 97, Maintenance of indoor electric lighting systems", 2005, ISBN 3-900-734-34-8. The values must be determined by the planner.

## Circuit Breaker Types

Automatic Circuit Breaker Type	Number of Fixtures
B10	2
B13	3
B16	4
B20	5
C10	4
C13	6
C16	7
C20	9